



# MTSE Multi-Trans Smart Ecosystem

- ✓ Measure, Sum, and Report up to 3 Systems (i.e. SA, RA, and OA) using 1 MTSE with up to 5 Sensors
- ✓ Measure up to 4 Additional Differential Pressure Points such as Filter Loading (i.e. Pre and Final Filter)
- ✓ Variable Sensor Configurations (i.e. 2 SF / 2 RF / 1 OA / 2 Filters, or 3 SF / 2 RF / 2 Filters, or 1 OA / 2 Filters etc.)
- ✓ Connects to Piezometer Rings Eliminating Fan Inlet Obstructions
- ✓ User Friendly Color Touchscreen and Menus
- ✓ Field Configuration Available with Intuitive Setup Wizard
- ✓ Single Point Comm Connection to BMS or Local Controller via Field Selectable BACnet or Modbus Protocols

## MTSE MULTI-TRANS SMART ECOSYSTEM

The **Multi-Trans Smart Ecosystem (MTSE)** is a flow and pressure transmitter that has been engineered to provide a cost effective solution for accurate ( $\pm 0.25\%$  F.S.) airflow measurement of up to three systems; perfect for air handling or rooftop units requiring supply and return fan/fan array and outside air intake monitoring. The MTSE can connect to each fan's existing piezometer-ring airflow sensors or to field installed airflow stations; up to five flow sensing points. The MTSE can simultaneously measure up to four additional differential pressure sensing points such as pressure drop across filters or coils, duct static pressure, and plenum pressure.

The total (summed) airflow rate for up to three individual flow systems and up to four differential pressure points is indicated on a 3.5-inch, Human-Machine-Interface (HMI) touch screen; individual flow and pressure sensing values are also accessible via touchscreen menus. The total airflow rate of each system is available to the Building Management System (BMS) or local controller via dedicated field selectable 0 to 10 VDC or 4 to 20 mA analog outputs and via field selectable BACnet®-MS/TP Master or Modbus® RTU Slave network communications. Independent flow and pressure values for each of the nine sensing points is also available to the BMS or local controller via network communication.

The MTSE can accept a temperature input signal for each system for air temperature indication and air density compensation for standard or actual airflow calculations.

The MTSE can be configured at the factory for plug and play installation or can be field configured using the Setup Wizard. Available menus include flow measurement configuration using the "Super-K", eliminating time spent supplying system configuration parameters for setup (such as area factors, piezometer constants, etc.)

## Additional Features

- Local display of each fan's airflow rate as well as the total airflow rate for each array
- Measurement of min and max OA flow rate for economizing
- Field Selectable Modbus RTU Slave & BACnet®-MS/TP Master Communication, Standard
- Standard impact resistant, flame retardant Polycarbonate NEMA 4X and IP66 rated enclosure
- $\pm 0.25\%$  F.S. Accuracy
- Super-K Factor to eliminate need for individual manufacturer's fan coefficients or area factors
- Calibrated using NIST Traceable Reference Standards
- Easy and intuitive 3.5-inch touchscreen display
- Software updates via MicroSD
- True AutoZero (optional)
- User defined high and low airflow alarm visual and BMS/BAS indication

## SPECIFICATIONS

### Performance Specifications

|  |  |
|--|--|
| Flow Summation   | Up to 3 Unique Systems (i.e. SA/RA/OA)                               |
| Flow Sensing Points  | Up to 5 Unique Transducers   |
| Additional Pressure Sensing Points   | Up to 4 Transducers (i.e. Filter Loading)                            |
| Accuracy   | +/- 0.25% F.S. <sup>1</sup>  |
| Long Term Stability  | 0.15% F.S. Annually  |
| Standard Response Time   | 1 second   |
| Warmup Temperature Shifts  | +/- 0.2% F.S. Span <sup>2</sup><br>+/- 0.2% F.S. Offset <sup>2</sup> |
| Proof Pressure   | 100 in. H2O  |
| Burst Pressure   | 300 in. H2O  |
| Pressure Media   | Non-corrosive, non-ionic dry gases and air                           |
| Alarm  | User defined high and low  |
| Display  | 3.5" Capacitive Touchscreen  |
| Note <sup>1</sup> : Accuracy includes typical linearity, hysteresis & repeatability. |  |
| Note <sup>2</sup> : Temperature shift relative to 77°F                               |  |

### Electrical Specifications

|                    |   |
|--------------------|---|
| Power Requirements | 20 - 28VAC/VDC  |
| Circuit Protection | Polarity Protected<br>Self-Resetting Fuse   |
| Power Consumption  | 8.5 Watts, 15.3 VA Max  |
| Digital Outputs    | (2) Open Collector Digital Outputs  |
| Digital Inputs     | (2) Dry Contact Digital Inputs  |
| Analog Outputs     | (4) 16-bit Analog Outputs<br>Field Selectable 0-10V & 4-20mA<br>Overvoltage and Overcurrent Protected |
| Analog Inputs      | (4) 12-bit Analog Inputs<br>Field Selectable 0-5V, 0-10V & 4-20mA                                     |
| Terminal Blocks    | Pluggable Screw Type  |
| Wiring             | 16 to 24 AWG  |

### Environmental Specifications

|                               |                                 |
|-------------------------------|---------------------------------|
| Operating Temperature         | -4°F to 158°F (-20°C to 70°C)   |
| Temperature Compensated Range | -4°F to 158°F (-20°C to 70°C)   |
| Storage Temperature           | -40°F to 257°F (-40°C to 125°C) |
| Operating Humidity            | 0 to 95% RH (non-condensing)    |

### Physical Specifications

|                      |   |
|----------------------|---|
| Pressure Connections | 1/4" OD Barbed Brass Fittings   |
| Dimensions           | 9.50" L x 5.69" W x 3.56" H   |
| Enclosure            | IP-66, NEMA 4X Rated<br>Fire Retardant Impact Resistant Polycarbonate |
| Mounting             | Built in top and bottom mounting tabs<br>1/4" Through hole            |
| Outer Connections    | Molded opening for 1/2" conduit fitting                               |
| Weight               | 2lbs  |


### Compliance

|                   |   |
|-------------------|---|
| UL                | Conforms to UL 94 V-0<br>Conforms to UL 50E   |
| CE                | RoHS directive 2011/65/EU<br>REACH 2006/95/EC |
| Conflict Minerals | DRC Conflict Free                             |
| FCC               | FCC Part 15, Subpart B                        |
| BACnet            | Application Specific Controller B-ASC         |


### Communications

|                          |                                |
|--------------------------|--------------------------------|
| Hardware                 | EIA-485                        |
| Supported Protocols      | Modbus RTU Slave, BACnet MS/TP |
| Modbus RTU data bits     | 8                              |
| Modbus RTU parity        | None                           |
| Modbus stop bits         | 1                              |
| Max communication length | 4000 ft. (EIA-485)             |

# DIMENSIONS

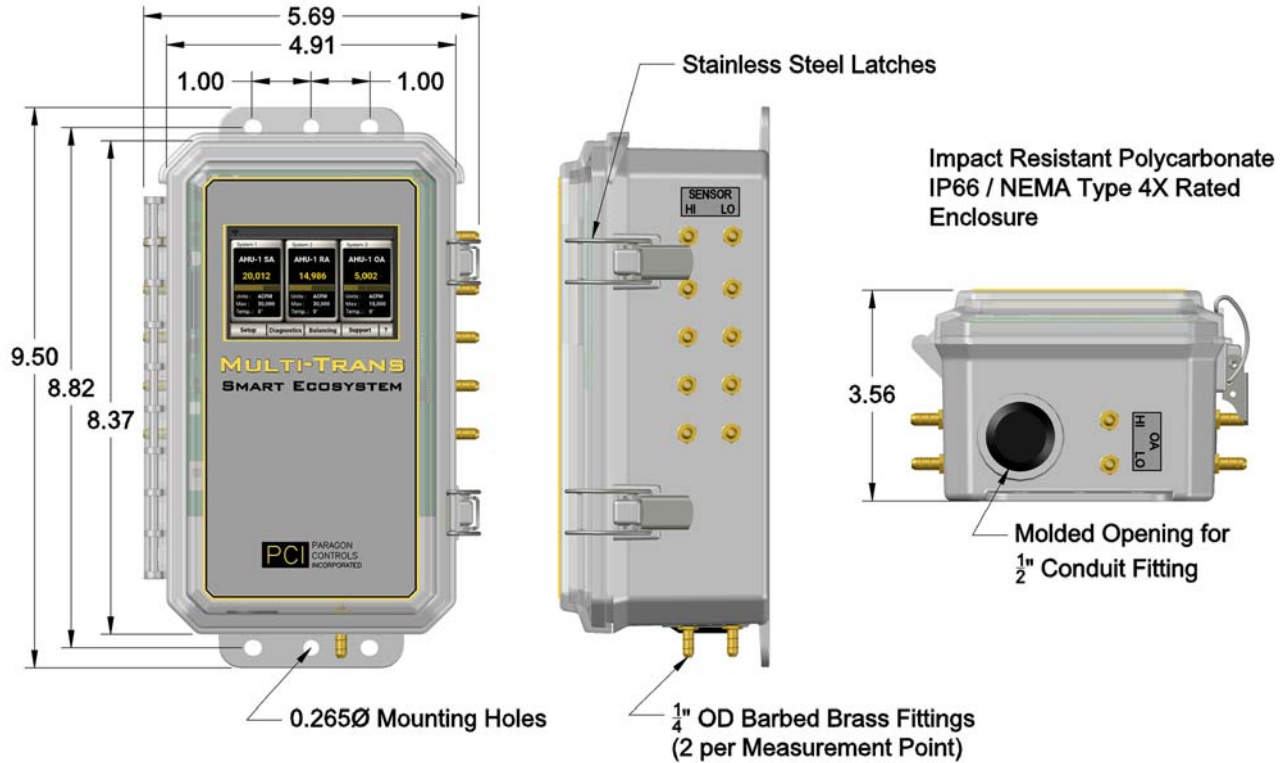

# ELECTRICAL CONNECTIONS

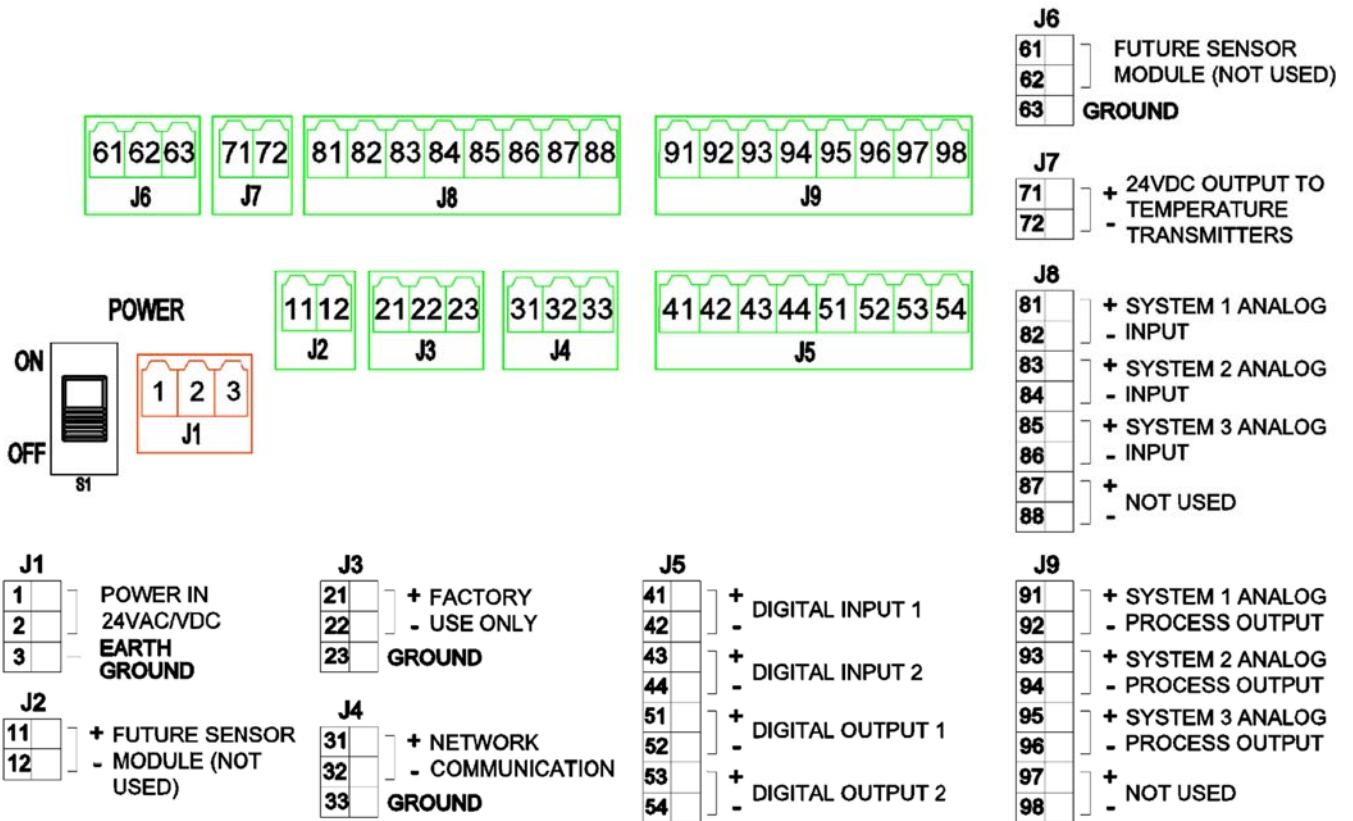

# MTSE Multi-Trans Smart Ecosystem

## SPECIFICATION GUIDE

### 1.1 Airflow and Pressure Measurement Systems

#### A. Airflow Sensors:

- i. Fan/Fan Array: Fan manufacturer shall provide airflow measurement pressure taps for each individual fan. If pressure taps are not available for the fans being supplied, the use of Pitot-type fan inlet airflow sensors is acceptable. Basis-of-Design Product: Subject to compliance with requirements, provide Paragon Controls Inc.; FE-1050 or equal as approved by the Engineer.
- ii. Outside Air Intake/Duct Systems: Airflow stations shall consist of multiple Pitot-type airflow sensors, factory mounted and pre-piped in a casing designed for flanged connection to ductwork, control dampers, louvers, etc. Sensor density shall comply with ANSI/ASHRAE Standard 111 for equal area traversing. Airflow stations with low sensor densities such as thermal dispersion and single or dual point differential pressure sensors are not acceptable. Subject to compliance with requirements, provide Paragon Controls Inc.; FE-1500 or equal as approved by the Engineer.

#### B. Airflow/Pressure Transmitters:

Each transmitter shall be designed to measure, sum, and report the flow rate of up to three systems (such as supply air, return air, and outside air) with up to five flow sensing points (such as fans/fan arrays, outside air intakes, and duct systems) and measure up to four additional independent differential pressure sensing points (such as pressure drop across filters or coils, duct static pressure, and plenum pressure) with an accuracy of  $\pm 0.25\%$  of full scale. The transmitter shall be housed in a hinged compact NEMA4X enclosure to provide flexibility in mounting location. Transmitter shall include a color touchscreen with on-screen keypad and setup wizard allowing for simple field configuration when required. Connection to the airflow sensor shall be by plenum tubing; flow sensors requiring transmitter connection using proprietary electrical cabling are prohibited. The total (summed) airflow rate for each system shall be available to the Building Management System (BMS) or local controller via dedicated field selectable 0 to 10 VDC or 4 to 20 mA analog outputs and via field selectable BACnet®-MS/TP Master or Modbus® RTU Slave network communications. Independent flow and pressure values for each of the nine sensing points shall also be available to the BMS or local controller via network communication. Transmitter software shall be upgradeable using MicroSD card. Basis-of-Design Product: Subject to compliance with requirements, provide Paragon Controls Inc.; MTSE or equal as approved by the Engineer.